



# THREE PHASE METER BASE WIRING

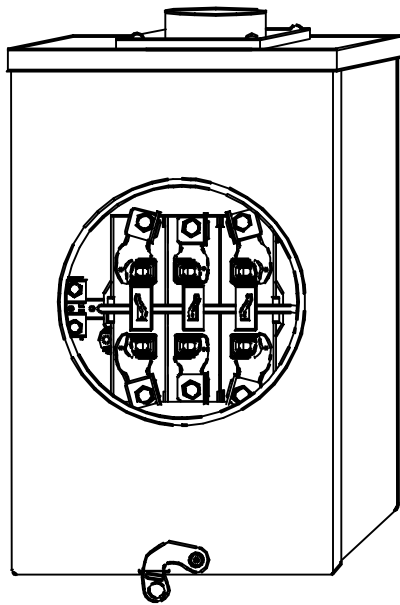


(COVER PLATE PROVIDED WITH METER BASE)  
GROUND WIRE OMITTED FOR CLARITY.


**TYPICAL SELF-CONTAINED OVERHEAD  
METER BASE FOR USED ON 4-WIRE 3  
PHASE SERVICES UP TO 240V.  
(FOR 480V, A LINE SIDE DISCONNECT IS  
REQUIRED.)**

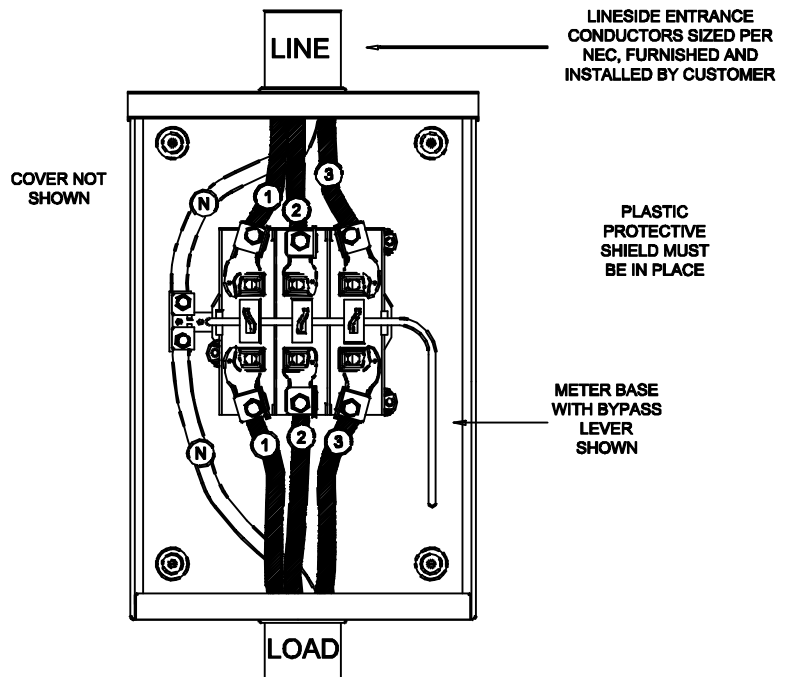

**TYPICAL SELF-CONTAINED UNDERGROUND  
METER BASE FOR USED ON 4-WIRE 3  
PHASE SERVICES UP TO 240V.  
(FOR 480V, A LINE SIDE DISCONNECT IS  
REQUIRED.)**

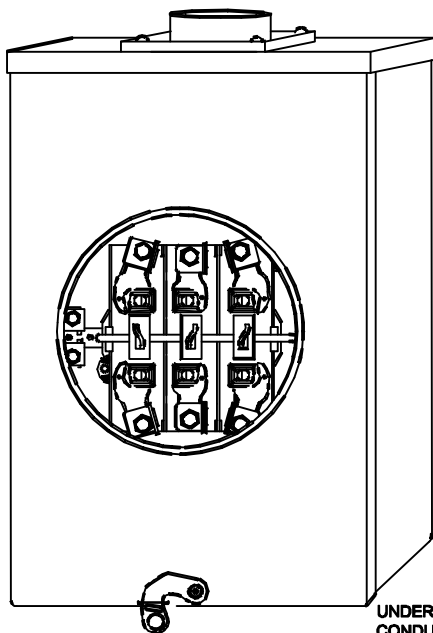

UNDERGROUND SERVICE  
CONDUCTORS SIZED PER  
NEC, FURNISHED AND  
INSTALLED BY CUSTOMER

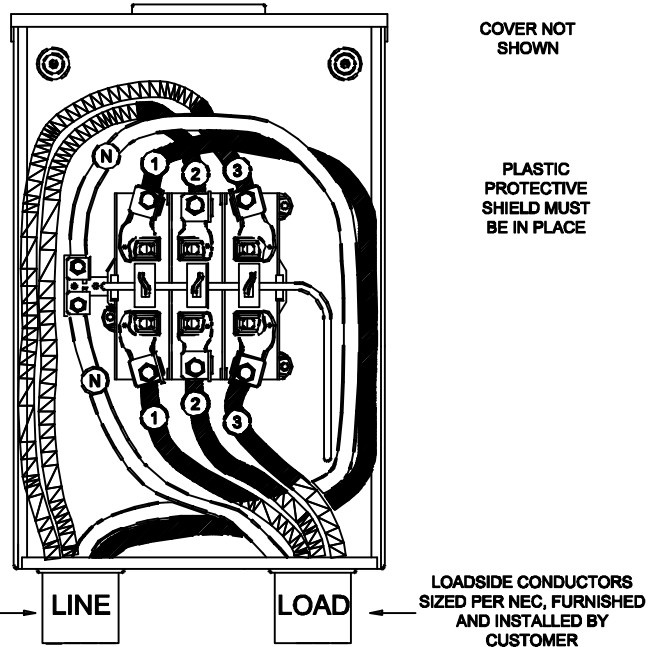

NOTE:  
CONDUITS SHALL ENTER THROUGH LEFT OR RIGHT KNOCKOUTS FOR  
UNDERGROUND SERVICE METER. NOT CENTER.