


GANGED AND MULTI-METER LABELING

NOTES:

1. THIS DRAWING DETAILS THE NUMBERING OF ELECTRIC MULTI-METER INSTALLATIONS.
2. NORTHCENTRAL PERSONNEL MUST VERIFY THE SERVICE HAVE BEEN MARKED WITH CORRECT UNIT NUMBER BY ELECTRICIAN.
3. SERVICE POINTS SHOULD BE PERMANENTLY MARKED WITH THE UNIT NUMBER ON THE INSIDE OF THE ENCLOSURE NEXT TO THE BLOCK USING PERMANENT MARKER OR PAINT PEN.
4. SERVICES ARE TO BE LABELED USING 1" HIGH POLYMER OR "MAILBOX" NUMBERS FOR EACH SERVICE AND ARE TO BE PLACED ABOVE EACH BREAKER WHICH SERVES THE UNIT.
5. NUMBERS MUST MATCH THE NUMBERING ON THE UNIT.
6. UNIT NUMBERS ARE NOT TO BE PLACED ON THE METER ENCLOSURE LIDS, WHICH COULD BE SWITCHED WITH ANOTHER UNIT, OR THE METER ITSELF, WHICH MAY BE REPLACED DUE TO DAMAGE, FAILURE, OR TAMPERING.

115B


1" DIGITS SHALL BE
SECURELY
ATTACHED.

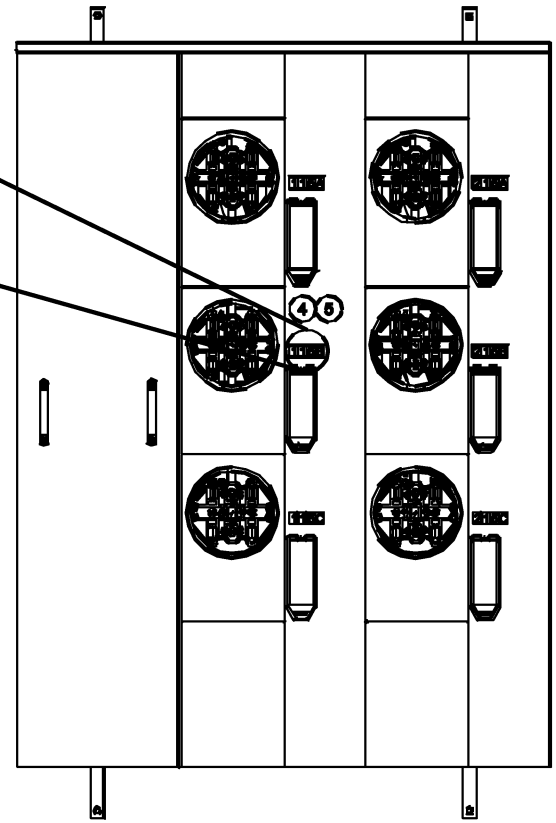

METER ENCLOSURE WITH COVER.

115B

MARK UNIT NUMBER
ON METER BASE
WITH PERMANENT
MARKER OR PAINT
PEN.

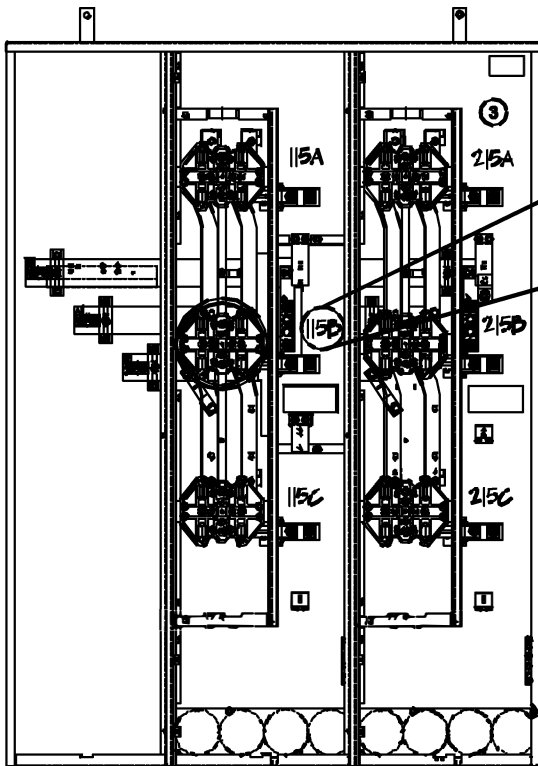

METER ENCLOSURE WITHOUT COVER