


Summary of NESC Clearances to Communication Cables - see NESC for details and exceptions

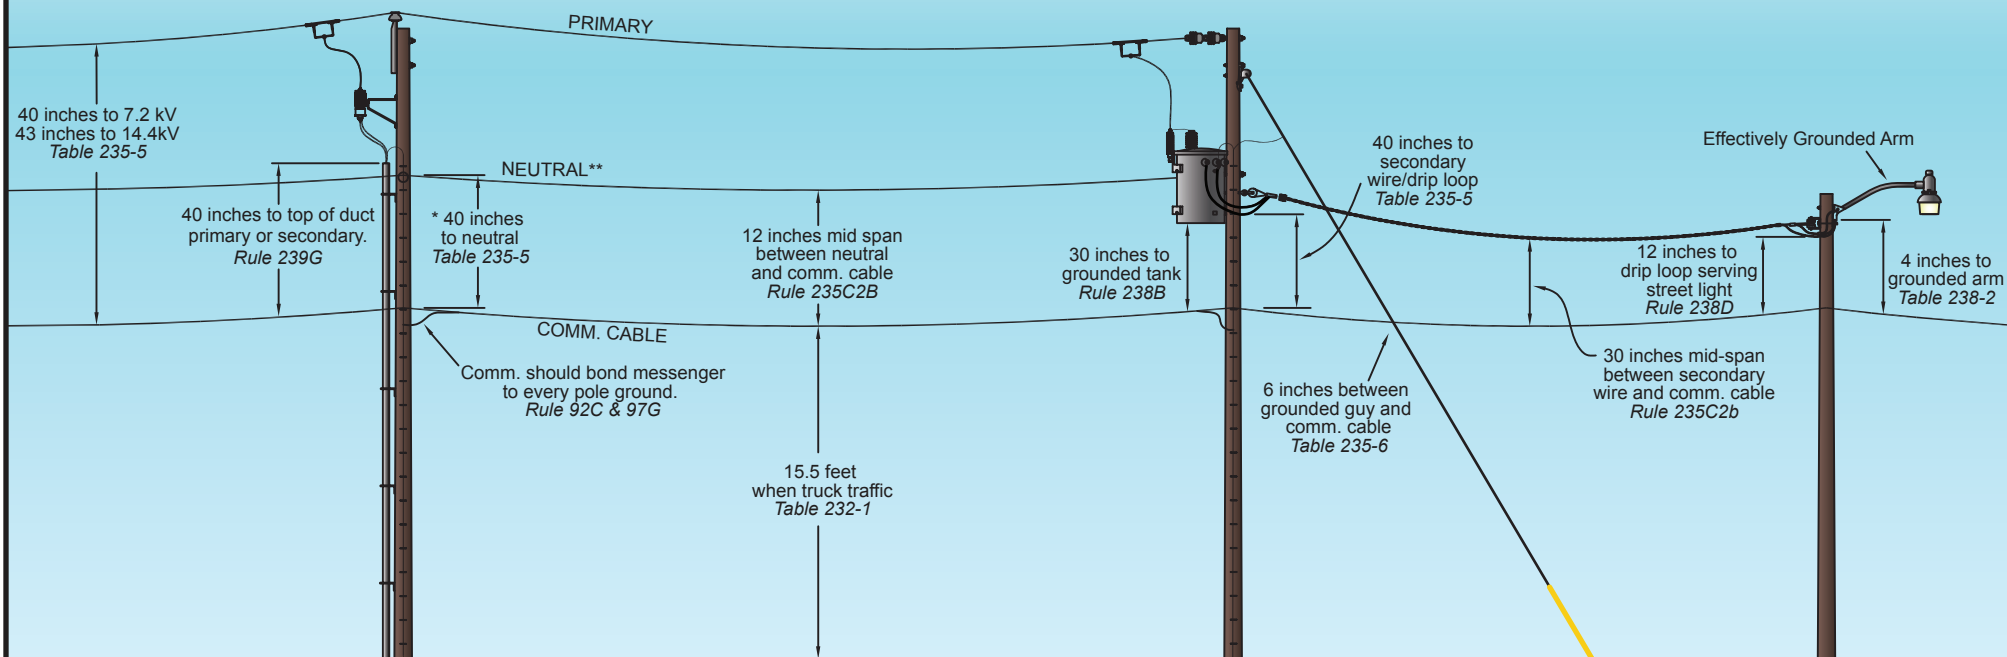

* 30 inches is allowed if the communication messenger is bonded to the neutral throughout the service area. *Table 235-5*

** Fiber Optic Cables in the supply space (*Rule 224A*) will have the same required clearance to communication cables in the communication space as a multi-grounded neutral (*Rule 235C*)

A communication worker safety zone is 40 inches of clearance between communication lines and supply lines/equipment per *Rule 235C4 & 238E*